
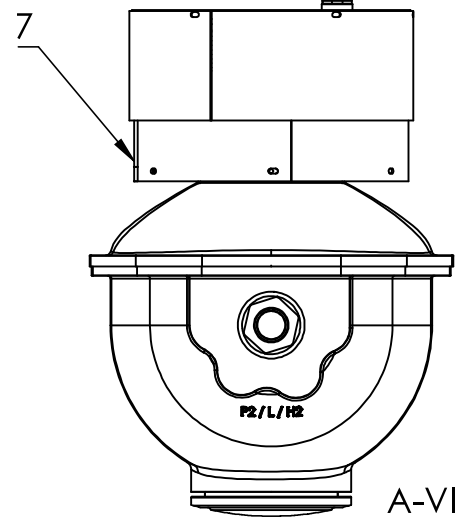


MATERIAL OF PRIMARY TERMINALS:
SILVER PLATED COPPER


TARİH/DATE:

REVİZON/REVISION


ONAY/APPROVED

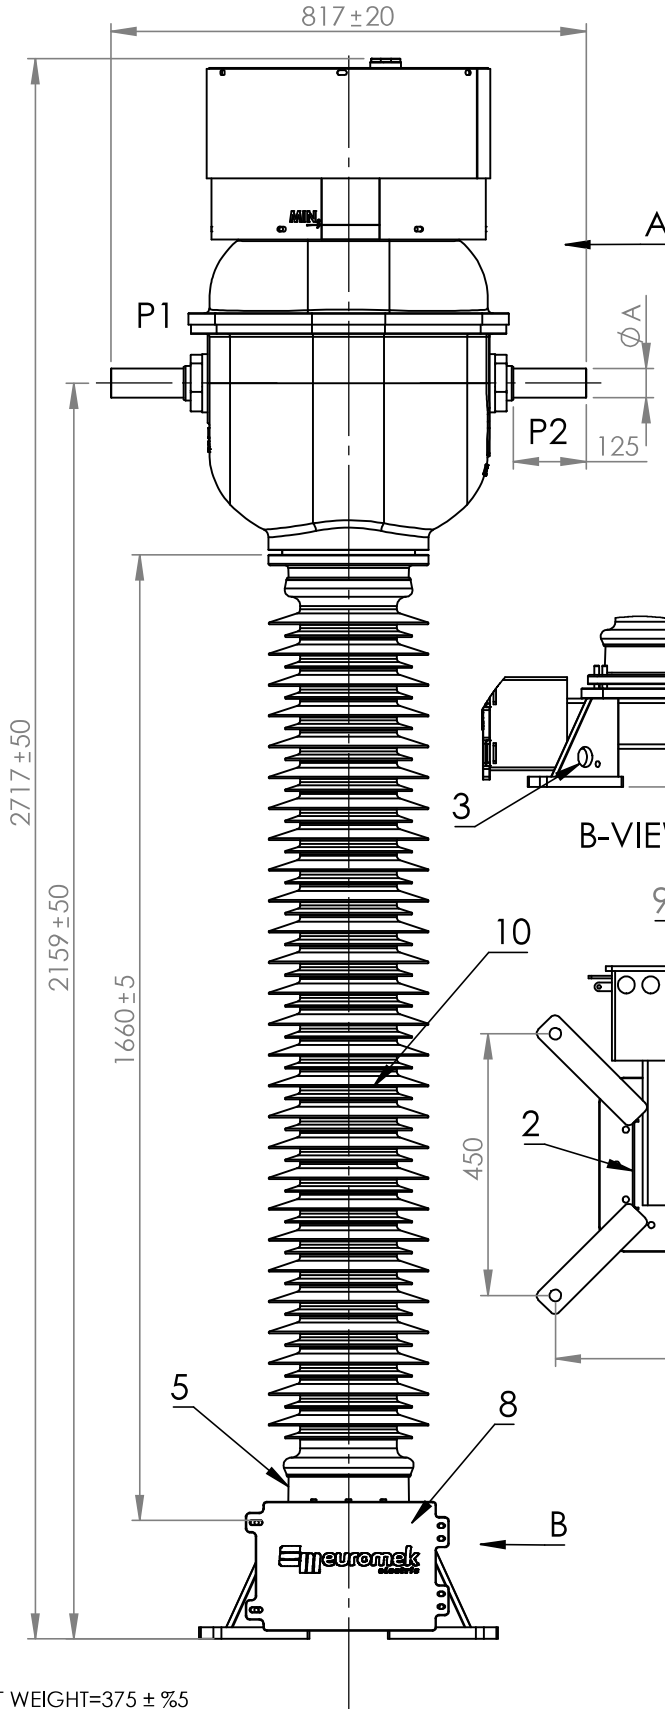

A-VIEW

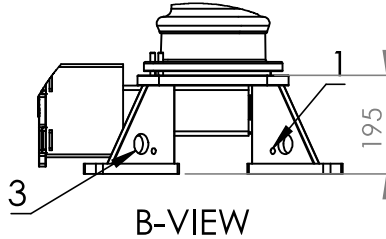

B-VIEW

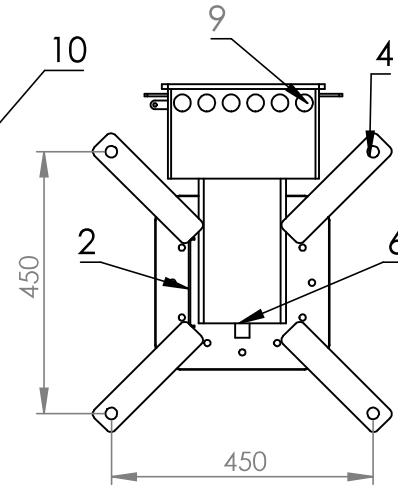

AMPER	A
<2000	Ø40
≥2000	Ø50

- 1- Two earthing screws
- 2- Rating plate
- 3- Four lifting holes
- 4- 4xØ20 fixing holes
- 5- Warning plate
- 6- Oil sampling valve
- 7- Below level indicator
- 8- Secondary terminal box, IP55
- 9- 6xPG21 cable glands
- 10- Composite insulator

NET WEIGHT=375 ± %5

İSİM/NAME	İMZA/SIGN	TARİH/DATE	MALZ./MATE.:	NOT/NOTE:
TASARIM/DESIGN.	Ş.ERCAN	30.05.2025	AĞIR./WEIG.:	1.
ÇİZEN/DRAW.	Ş.ERCAN	30.05.2025	HAC./VOL.:	2.
KONTROL/CONT.	E.TEKİN	30.05.2025	KAPL./COAT.:	PARÇA ADI / DRAWING NAME:
ONAY/APPR.	N.AKTAŞ	30.05.2025	TOLERANS/TOLERANCE	TRA 123
EUROMEK ELECTRIC Akıllı Mahallesi OSB 2 2014 Sokak NO:27 Sincan/Ankara TEL: +90 0312 666 90 56 E-MAIL: euromek@euromek.com.tr			ÇİZİMDE BELİRTİLMİŞ TOLERANSLAR, İŞLEM İÇİN TS 1980 VE KABA SERİLERDE KAYNAK İÇİN ISO 13290 A GÖRE BELİRTİLMİŞTİR. UNSPECIFIED TOLERANCES IN THE DRAWING ARE ACCORDING TO TS 1980 FOR MACHINING AND ISO 13290 FOR WELDING IN ROUGH SERIES	PARÇA NO/ PART NO: A.01.123.0008
www.euromek.com.tr			ÖLÇEK/SCALE KAĞIT/SHEET 1:15 A4	SAYFA/SHEET
			KAL.KONT.SEVİYESİ/QLT.CONT.LEVEL	